

**ENGINEERING DEPARTMENT**  
**693A Spanish Town Road, Kingston 11**  
**Tel 937-9320-5, Fax 937-9259**  
**T & D MATERIAL SPECIFICATION**

**JPS Specification #: FM4S2019**

**Date: February 20, 2019**

**Item Stock:**

**Supersedes: All Previous**

**Description:** Enclosure, Meter, Form 4S,1PH,600V,20A, Weather Proof.

**Application:** For installation of transformer-rated meter


**SPECIFICATION**

**Enclosure, Meter, Form4S,1PH,600V,20A, Weather Proof. To be used for housing meters utilized in CT metering.**

The enclosure shall be constructed of material 0.080 aluminum mill finish, with dimensions 15" (H) X 9-1/8"(W) X 3-1/2" (D).

The Enclosure shall be able to accept 3-wire form 4S watt hour meters and shall have 6 terminals with a plunger bypass. The plunger bypass shall automatically closes when the meter is removed. There shall be a high voltage warning label affixed to the front of the enclosure. The meter shall have a stainless steel swinging latch and hasp. The enclosure shall be Nema type3.

**The enclosure shall be Brooks Utility Products  
CatNo. 601-3010C6-XMK or approved equal**

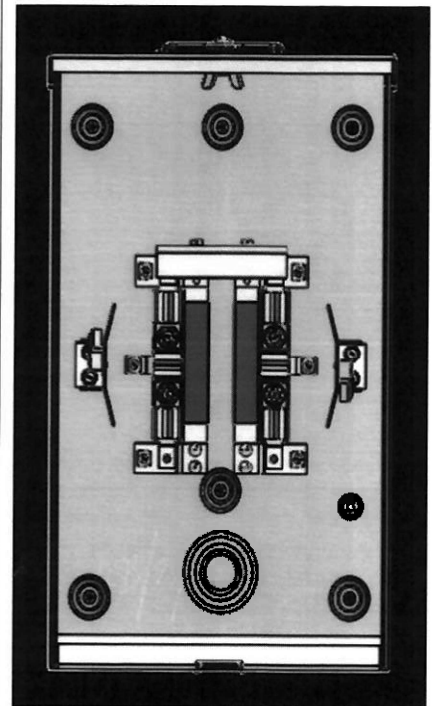

**Prepared By:**

*U. Tobin* 20/2/19

**Uton Tobin**  
**Standards Engineer Specialist**  
**Engineering Standards and Testing Services**

**Approved By:**

*Osawaki Wickham* FEB/20/2019

**Osawaki Wickham**  
**Manager**  
**Engineering and Construction**